


#### Recommended Control Box Positioning

Site the control box preferably to an upright surface, in an accessible service void, adjacent to or below the display unit (minimum clearance below underside of display unit = 200mm).


#### Incorrect Control Box Positioning

The control box must not be located

- 1) directly to the underside of the display unit,
- 2) above a hot cupboard or,
- 3) where ambient temperature is above 40°C,
- 4) where likely to allow ingress of water i.e. wet floor areas.

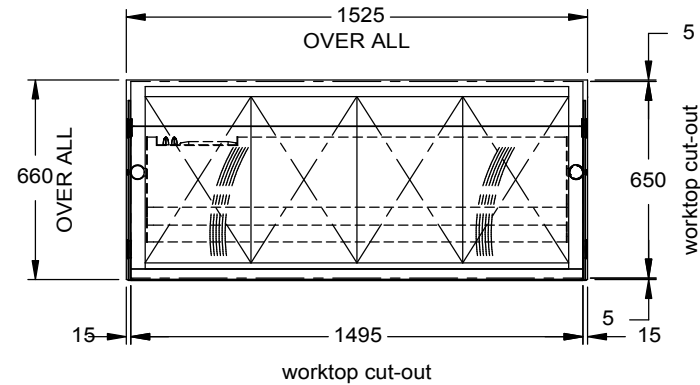


PLAN VIEW

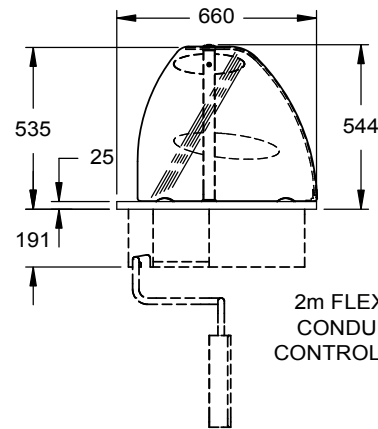

END VIEW

2m FLEXIBLE  
CONDUIT TO  
CONTROL BOX


CONTROL BOX  
(4 x M4 FIXINGS)

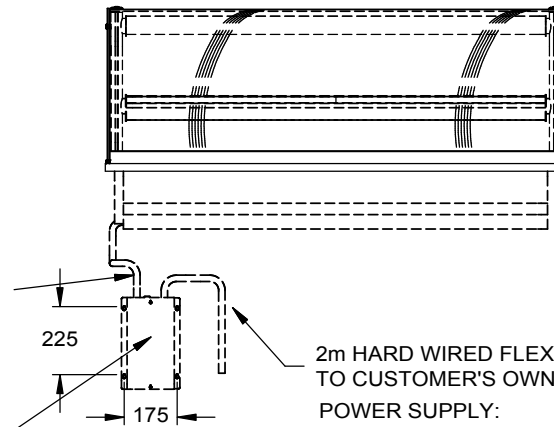

FRONT VIEW  
(CUSTOMER SIDE)

2m HARD WIRED FLEXIBLE CONDUIT FOR WIRING  
TO CUSTOMER'S OWN JUNCTION BOX OR SUPPLY  
POWER SUPPLY:  
20A, 230V, 3.8kW

GANTRY MOUNTED DIGITAL  
CONTROL PANEL

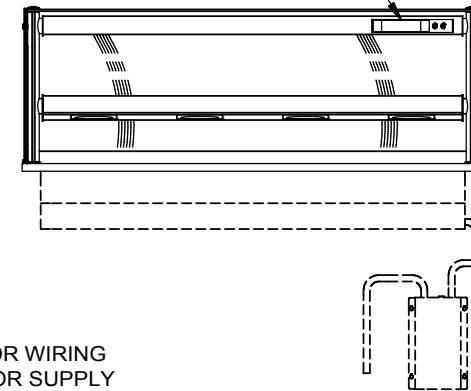

REAR VIEW  
(OPERATOR SIDE)


APPROX. UN-CRATED  
WEIGHT OF UNIT: 118Kg



CED FABRICATIONS LTD  
UNITS A1-A4, FALCON COURT  
CLAYTON BUSINESS PARK  
CLAYTON-LE-MOORS  
HYNDBURN  
LANCASHIRE BB5 5JD

This drawing and information herein is confidential to CED Fabrications Ltd.  
It is issued in confidence that it will not be disclosed to any third party in part or in whole without permission from CED FABRICATIONS Ltd.

© CED FABRICATIONS LTD



#### DESCRIPTION:

DESIGNLINE DROP-IN HEATED  
4-1 G<sub>n</sub> DELI

SCALE: 1 : 25 @ A4

REV No: 1

PRODUCT  
CODE:

HDL 4