

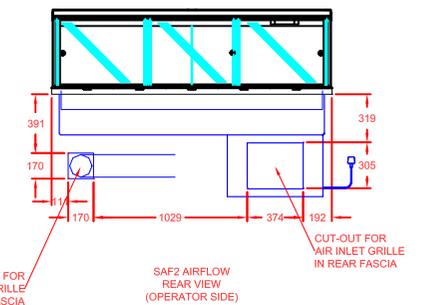
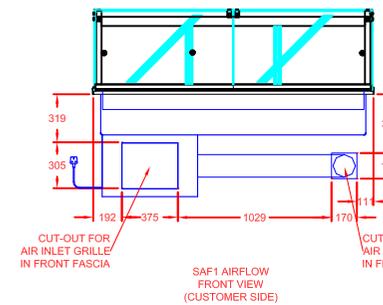
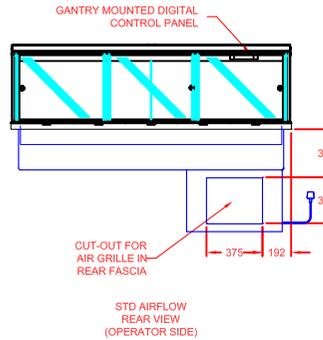
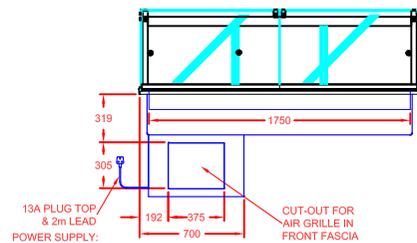

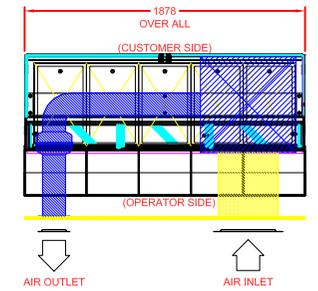

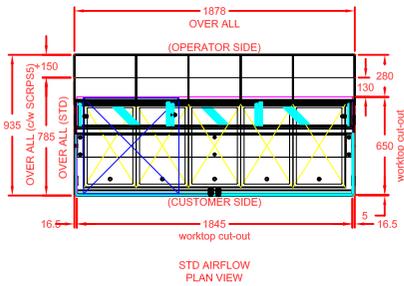
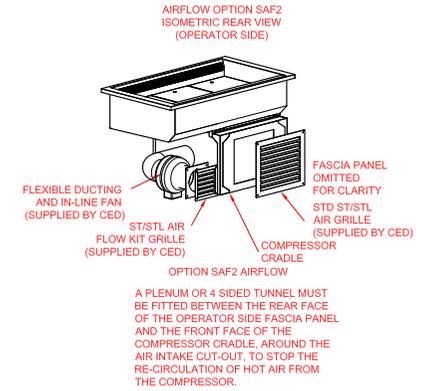
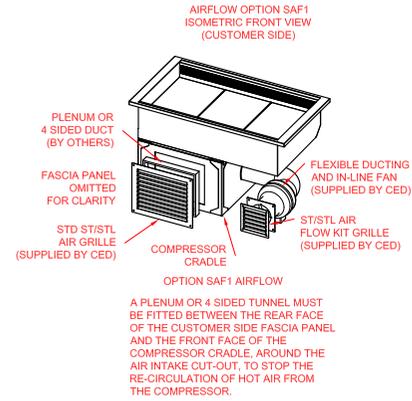
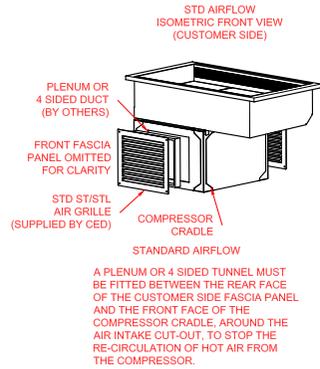


Ventilation / Display Performance Considerations

- 1) Area in which display is to be sited must have a minimum room floor area no less than 28 sq.m.
- 2) Install over a sealed floor or ventilated floor void.
- 3) Do not site the display within 2m of ceiling mounted air conditioning grilles.
- 4) Do not site the display beneath a high level of direct sunlight.
- 5) Display will operate in a 24 hour environment.
- 6) Access to maintain condensing unit should be made via removable fascia panels or doors to customer and operator side of counter.

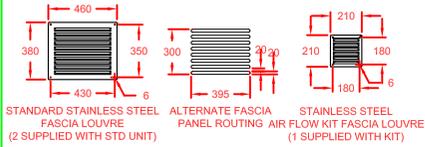

CED FABRICATIONS LTD
UNITS A1-A4, FALCON COURT
CLAYTON BUSINESS PARK
CLAYTON-LE-WOODS
HYDBURN
LANCASHIRE BB5 5JD

This drawing and information herein is confidential to CED Fabrications Ltd. It is issued in confidence that it will not be disclosed to any third party in part or in whole without permission from CED FABRICATIONS Ltd.

© CED FABRICATIONS LTD



APPROX UN-CRATED WEIGHT OF UNIT: 204KG

DESCRIPTION:	SCALE: 1:25@A1	REV No: -
SCENIC DROP-IN CHILLED 5-1 G0 DELI (ASSISTED SERVE) HYDROCARBON TYPE-R290 REFRIGERANT	PRODUCT CODE:	SCDL5ASHT